



Force Engineering & Testing Inc.
19530 Ramblewood Drive
Humble, TX 77338

Product Evaluation Report
GOLDIN METALS, INC.

Min. 26 Ga. PBR Roof Panel over steel framing

Product Manufacturer:

Goldin Metals, Inc.
12440 Seaway Road
Gulfport, Mississippi 39503

Engineer Evaluator:

Terrence E. Wolfe, P.E.
Mississippi #13566

Contents:

Evaluation Report Pages 1 – 3



April 25, 2018
PAGE 1 OF 3



Compliance Statement: The product as described in this report has demonstrated compliance with the International Building Code 2015, Sections 1504.3.2

Product Description: PBR Roof Panel, 26 Ga. Steel, 36" Wide, through fastened structural roof panel. Structural Application.

Panel Material/Standards: Material: Min. 26 Ga. Steel, ASTM A792 unpainted or painted or ASTM A653 G90 conforming to International Building Code 2015 Section 1507.4.3.
Yield Strength: Min. 80.0 ksi
Corrosion Resistance: Panel Material shall comply with International Building Code 2015, Section 1507.4.3

Panel Dimension(s): Thickness: 0.0185" min.
Width: 36" coverage
Rib Height: 1-1/4" major rib at 12" O.C.

Panel Fastener: #12-14 x 1-1/4" HWH SD with sealing washing or approved equal at 12"-12"-12" fastener pattern. Panel side laps fastened together w/ #12-14 x 3/8" HWH Sharp Point w/ sealer washer at 20" O.C.
Corrosion Resistance: Per International Building Code 2015, Section 1507.4.4.

Substrate Description: Min. 16 Ga. Steel Framing. Framing must be designed in accordance w/ International Building Code 2015.

Allowable Uplift Design Pressures:

Table "A"

| | |
|---------------------------------|-------------|
| Maximum Design Uplift Pressure: | -42.7 psf |
| Fastener Pattern: | 12"-12"-12" |
| Fastener Spacing: | 5'-0" O.C. |

*Design Pressure includes a Safety Factor = 2.0.



Terrence E. Wolfe
April 25, 2018

Code Compliance: The product described herein has demonstrated compliance with The International Building Code 2015, Section 1504.3.2.

Evaluation Report Scope: The product evaluation is limited to compliance with the structural wind load requirements of the International Building Code 2015.


Performance Standards: The product described herein has demonstrated compliance with:

- ASTM E 1592-05 (2012) Test method for structural performance of sheet metal roof and siding systems by uniform static air pressure difference.


Reference Data:

- ASTM E 1592-01
Farabaugh Engineering & Testing, Inc., Test report T166-05


Test Standard Equivalency: The ASTM E 1592-01 test standard is equivalent to the ASTM E 1592-05 (2012) test standard.

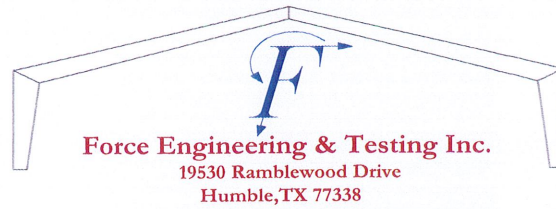

- Quality Assurance Entity:** The manufacturer has established compliance of roof panel products for manufacturing under a quality assurance program audited by an approved quality assurance entity.
- Minimum Slope Range:** Minimum Slope shall comply with International Building Code 2015, including Section 1507.4.2 and in accordance with Manufacturers recommendations. For slopes less than 3:12, lap sealant must be used in the panel side laps.
- Installation:** Install per manufacturer's recommended details.
- Insulation:** Manufacturer's approved product (Optional)
- Roof Panel Fire Classification:** Fire classification is not part of this acceptance.
- Shear Diaphragm:** Shear diaphragm values are outside the scope of this report.
- Design Procedure:** Based on the dimensions of the structure, appropriate wind loads are determined using Chapter 16 of the International Building Code 2015 for roof cladding wind loads. These component wind loads for roof cladding are compared to the allowable pressure listed above. The design professional shall select the appropriate erection details to reference in his drawings for proper fastener attachment to his structure and analyze the panel fasteners for pullout and pullover. Support framing must be in compliance with International Building Code 2015 Chapter 22 for steel, and Chapter 16 for structural loading.

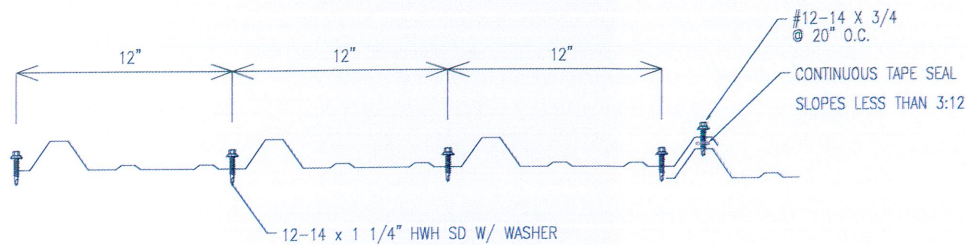

INTERIOR SCREW PATTERN

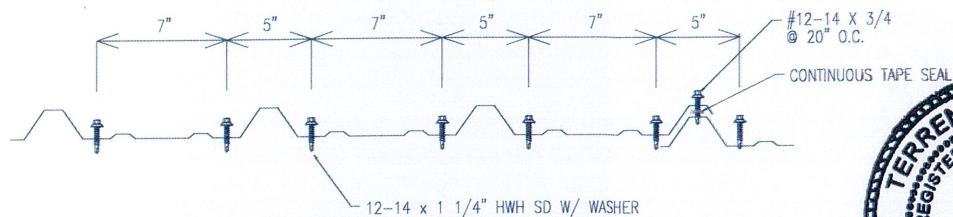

PANEL ENDS/END LAP PATTERN



Terrence E. Wolfe
 April 25, 2018
 PAGE 3 OF 3